


11. **CONCRETE CURING:** The contractor will be responsible to oversee the work until such time that it has cured to ensure that the finish is maintained. Failure on the part of the contractor to abide by this regulation could result in orders to remove and replace any sections that become damaged prior to curing.
12. If a curb is poured with the sidewalk, a six inch curbing trowel must be used to form the edge of the curb.

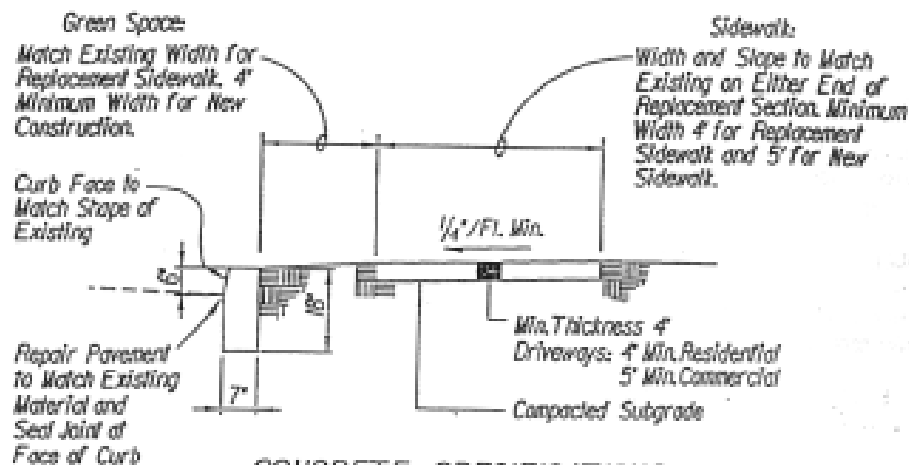

### CONCRETE SPECIFICATIONS:

Concrete Strength 4000 psi at 28 Days  
Air Entrainment 6% ± 1%

### NOTES:

Joints Shall be Replaced in Kind as Either Construction/Expansion Joints or Contraction Joints.

Joint Spacing Shall Match Existing With Maximum Spacing not to Exceed 5 Feet.

## SIDEWALK AND CURB REPLACEMENT DETAIL

City of Bellevue, Ky